

SPE8□□□-NE Single-Phase Power Parameter Acquisition Module




scan the QR code to learn more

User Manual

I. Precautions

- Do not operate this product beyond its design limits under any circumstances.
- The power supply for this product is 24V DC. Strictly prohibit the use of 220V AC power.
- This product should be installed in a safe location. The shell's maximum withstand temperature is +85°C.
- When used in environments with strong magnetic interference, Shielded cable is recommended for signal lines.
- Strictly prohibit unauthorized disassembly, modification, or repair of this product.
- Pay attention to the wiring method of this product to ensure correct Wiring and avoid damaging the product.
- Read this manual carefully before installation and use. If you have any questions, please contact our technical support personnel or refer to relevant technical guidance videos.
- Our company is not responsible for damage to components other than this product during use.
- Please download the latest electronic version of the documentation. The content of this manual is for reference only. We continuously improve the user experience, and technical parameters are subject to change without notice.

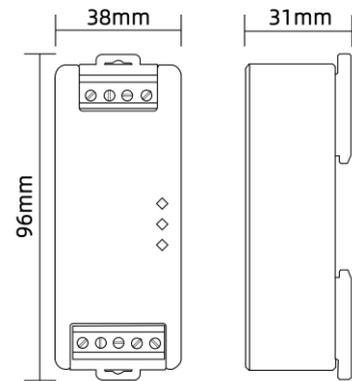

II. Product Dimensions

- Product dimensions: **96mm (L) X 38mm (W) X 31mm (H)**
- Industrial-grade flame-retardant plastic shell, standard DIN35 rail mounting.

III. Operating Environment

- Do not expose this product to excessively high or low temperatures.
- The surrounding environment must be free from strong vibration, impact, and electromagnetic interference such as large currents and sparks.
- The operating environment must not contain harmful substances that cause severe corrosion to metal or plastic components. Do not use or store the product in harsh environments, otherwise it will affect the electrical performance of the product.
- Operating Temperature: -40°C ~ +80°C Relative Humidity: 10% ~ 90%RH (non-condensing)

IV. After-Sales Service

We are committed to providing you with comprehensive after-sales service and warranty policy. The product warranty period is three years. During the warranty period, if the product fails due to non-human factors, we will provide free repair or replacement service. Damage caused by violation of operating regulations and requirements will require payment of parts cost and repair fee. After the warranty period expires, we continue to provide technical support and assistance. During this period, replacement parts are provided at cost price.

V. Application Fields



Automation Equipment



Medical Electronics



Remote Monitoring



Process Control

· Product Introduction

The SPE electrical energy signal data acquisition module is meticulously designed based on a new generation of embedded systems. Equipped with an isolated communication interface, it can communicate independently with a PC or PLC, or be networked with multiple communication modules. It also features a transient suppression circuit that effectively suppresses various surge pulses, ensuring reliable operation in harsh environments.

The SPE8□□□-NE series electrical energy parameter acquisition module supports single-phase AC current acquisition, single-phase AC voltage acquisition, and single-phase power acquisition. It is equipped with an RS485 communication interface and integrates three Delta-Sigma ADCs along with a high-precision energy metering core, achieving a resolution of up to 19 bits and a measurement accuracy better than 0.05%. The power supply, input, and communication outputs are isolated from each other, making it suitable for various industrial applications and automation systems. It facilitates communication with host computers, enabling rapid networking and the construction of monitoring systems.

This product requires an independent power supply and is mounted on a standard 35mm DIN rail, offering simple on-site installation and flexible use, adapting to a variety of field applications.

· Technical Parameters

Basic Parameters	
Power Supply	DC12~36V(DC24V recommended)
Power Consumption	<1.0W
Temperature Drift	≤200ppm/°C
Sampling Frequency	≤3Hz
Isolation Voltage	3000VDC
Power Protection	Reverse connection voltage< -40V
Dielectric Strength	1500 VAC / 1 minute (Power, Input, Output)
Insulation Resistance	≥100MΩ (power, input, output)
EMC Compatibility	Complies with GB/T18268.1 (IEC61326-1)
Applicable Field Devices	Configuration software, PLCs, touch screens, computers, and other devices supporting the MODBUS-RTU protocol
Input Terminal	
Acquisition Channels	2 Channels
Input Signals	One AC voltage<500V, one load current<500V
Input Range	The input range is referred to in the product name
Input Frequency	45Hz to 65Hz
Output Terminal	
Output Signal	RS-485 communication signal
Communication Protocol	Standard MODBUS-RTU protocol
Communication Distance	1200m (typical)
Voltage Accuracy	<0.05%FS (+25 °C)
Current Accuracy	<0.05%FS (+25 °C)
Active Power Accuracy	<0.05%FS (+25 °C)
Apparent Power Accuracy	<0.05%FS (+25 °C)
Frequency Accuracy	±0.1Hz
Environmental Conditions	
Operating Temperature	-40°C~+80°C
Storage Temperature	-40°C~+85°C
Relative Humidity	10%~90%RH (non-condensing)
Atmospheric Pressure	80kPa~106kPa


· Terminal Description

Terminal Mark	Function Description
VIN	Power supply positive terminal, DC12-36V input
0V	Power supply negative terminal
GND	RS-485 communication signal ground
A+	RS-485 communication signal positive terminal
B-	RS-485 communication signal negative terminal
CT+	Current signal acquisition, connected to an external current transformer
CT-	Current signal acquisition, connected to an external current transformer
UN-	Voltage input signal acquisition, single-phase input with neutral (N) wire
UL+	Voltage input signal acquisition, single-phase input with line (L) wire


· Indicator Description

Indicator Mark	Function Description
PWR	Power indicator
SYS	Input signal status indicator, flashes when no signal is present
COMM	RS485 communication indicator, flashes when data is being sent

· Wiring Method

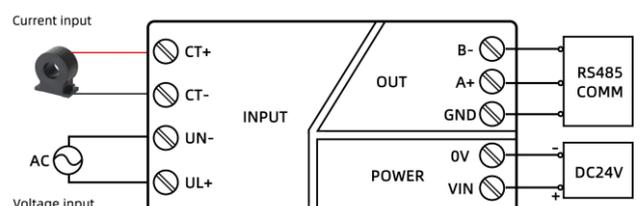


Module working principle

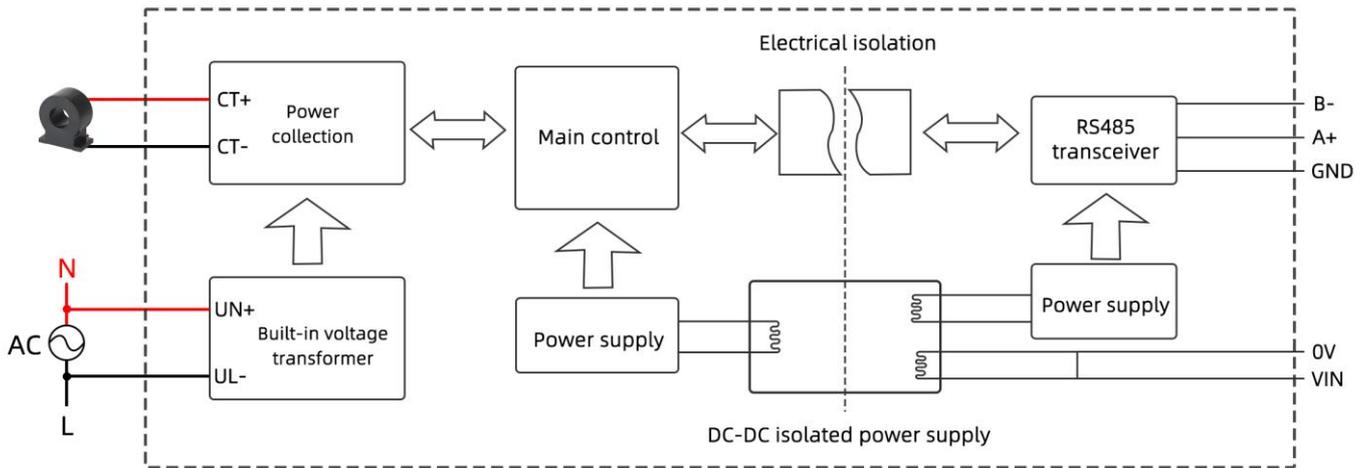


Installation Instructions

This module uses the DIN35mm rail mounting method. The rail should comply with the installation dimension specifications for the TH35-7.5 type rail according to the national standard GB/T19334-2003. Users can easily install or remove the module on the rail. Installation must be stable and secure. This module also supports screw mounting without a rail.

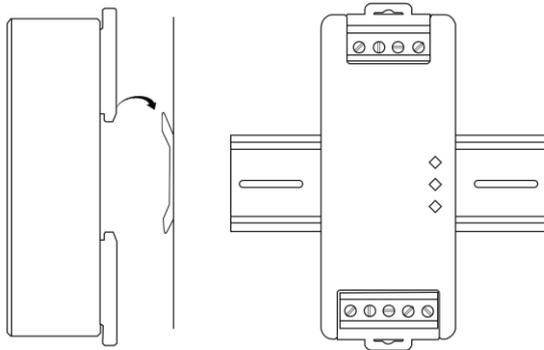

- Installation method of guide rail -

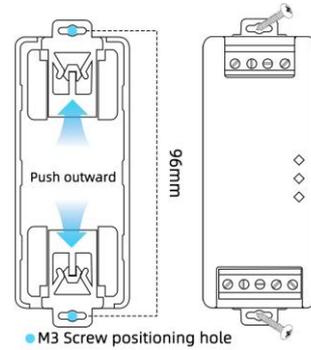

- Screw installation method -

Product Naming Rules

Taking SPE8020-NE01L as an example: Energy parameter acquisition module, 0-500V input, 0-20A input, no analog output, RS485 communication function, module DC12-36V power supply, N shape

SPE	8	02	0	N	E	0	1	L
Product Type	Signal Type	Number of Channels	Input Range	Product Form Factor	Acquisition Resolution	Analog Output	Comm Method	Power Supply
Electric signal acquisition module	1 AC voltage 2 AC current 3 Active power 4 reactive power 5 apparent power 6 frequencies 7 power factor 8 Comprehensive Electric Energy 9 Customization	1-32	1 0-10A 0-500Vac 2 0-20A 0-500Vac 3 0-20A 0-500Vac 4 0-50A 0-500Vac 9 Other	N Form Factor K Form Factor M Form Factor W Form Factor F Form Factor R Form Factor Y Form Factor Q Form Factor	A 12-bit ADC B 16-bit ADC C 24-bit ADC D 32-bit ADC E 19-bit ADC	0 No Output 1 0-5V 2 0-10V 3 4-20mA 4 0-20mA	0 No Comm 1 RS485 2 ETH 3 RS485+ETH 4 CAN 9 Other Comm	L DC12-36V H AC220V C +12V D +24V

• MODBUS-RTU Communication Protocol

The MODBUS-RTU protocol defines multiple function codes to achieve different functions. This manual explains the message format for commonly used function codes. This module only supports some of these function codes: 0X03, 0X04, 0X06, 0X10.

Function Code	Register add	Function Description
0X01	0XXXX	Read Coil Status (bit operation), e.g., read relay or digital output current state (ON/OFF)
0X02	0XXXX	Read Input Status (bit operation), e.g., read one or more groups of digital input states (ON/OFF)
0X05	0XXXX	Write Single Coil (bit operation), e.g., force a relay or digital output ON/OFF
0X03	4XXXX	Read Holding Registers
0X04	4XXXX	Read Input Registers (can be replaced by 0X03)
0X06	4XXXX	Write Single Holding Register
0X10	4XXXX	Write Multiple Holding Registers

• Communication Parameter Settings

Parameter	Setting Range	Default Value
Address	1~247	1
Baud Rate	1200、2400、4800、9600、14400、19200、38400、56000、57600、115200	9600
Parity	None, Even, Odd	None
Stop Bits	1, 2, 0.5, 1.5	1

• Communication Protocol Description

This communication board complies with the MODBUS RTU bus protocol, RS485 interface. The communication format is 11 bits:

1 start bit

8 data bits

1 parity bit (if used)

1 stop bit (with parity), 2 stop bits (without parity)

Data type: Unsigned int

With Parity

Start Bit	1	2	3	4	5	6	7	8	Parity Bit	Stop Bit
-----------	---	---	---	---	---	---	---	---	------------	----------

Without Parity

Start Bit	1	2	3	4	5	6	7	8	Stop Bit	Stop Bit
-----------	---	---	---	---	---	---	---	---	----------	----------

The message frame starts with a silence interval of more than 3.5 character times. The first field transmitted is the module add, followed by the function code, then the register add then the data, followed by the CRC16 check. It ends with a silence interval of more than 3.5 character times. The frame format is as follows:

Start Bit	Module add	Function Code	Register add High Byte	Register add Low Byte	Register Data High Byte	Register Data Low Byte	CRC16 calibration	End
>3.5 Chars	1 Byte	1 Byte	1 Byte	1 Byte	1 Byte	1 Byte	2 Byte	>3.5 Chars
	1-247	0X03 0X06	0X00	0X01	0X00	0X01	CRC	

Function Code: 0X01

1.Host Request Frame:

1 Byte	2 Byte	3 Byte	4 Byte	5 Byte	6 Byte	7 Byte	8 Byte
ADR	0X01	Start address Hi	Start address Lo	Qty Hi	Qty Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	coil start address to be read		number of coils to be read		CRC16 checksum from bytes1 to 6	

2.Slave Response Frame (Correct) : Coil status 0 = OFF and 1 = ON

1	2	3	4、5	6、7	N-1、N	N+1	N+2
ADR	0X01	Coil status Byte Count	Coil Status 1 Data	Coil Status 1 Data	Coil Status N Data	CRC16 Lo	CRC16 Hi
Module address (1~247)	Function code	Returns the number of bytes in coil status	Returns the wire net status data (one coil status is two bytes)				CRC16 checksum from bytes 1 to N	

Function Code: 0X02

1.Host Request Frame:

1	2	3	4	5	6	7	8
ADR	0X02	Start address Hi	Start address Lo	Qty Hi	Qty Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	The coil input start address to be read		number of coils to be read		CRC16 checksum from bytes1 to 6	

2.Slave Response Frame (Correct) : Coil status 0 = OFF and 1 = ON

1	2	3	4、5	6、7	N-1、N	N+1	N+2
ADR	0X02	Coil status Byte Count	Coil Status 1 Data	Coil Status 1 Data	Coil Status N Data	CRC16 Lo	CRC16 Hi
Module address (1~247)	Function code	Returns the number of bytes in coil status	Returns multiple coil input status data				CRC16 checksum from bytes1 to N	

Function Code: 0X05

1.Host Request Frame: Coil status 0 = OFF and 1 = ON

1	2	3	4	5	6	7	8
ADR	0X05	Coil address Hi	Coil address Lo	Force Data Hi	Force Data Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	Written coil address		Number of coils written		CRC16 checksum from bytes1 to 6	

2.Slave Response Frame (Correct) :

1	2	3	4	5	6	7	8
ADR	0X05	Coil address Hi	Coil address Lo	Force Data Hi	Force Data Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	Written coil address		Returns coil status data		CRC16 checksum from bytes1 to 6	

Function Code: 0X03

1.Host Request Frame:

1 Byte	2 Byte	3 Byte	4 Byte	5 Byte	6 Byte	7 Byte	8 Byte
ADR	0X03	Start address Hi	Start address Lo	Reg Qty Hi	Reg Qty Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	The register starting address to read is		Number of registers read		CRC16 checksum of bytes 1 to 6	

2.Slave Response Frame (Correct) :

1	2	3	4、5	6、7	N-1、N	N+1	N+2
ADR	0X03	Byte Count	Reg 1 Data Hi	Reg 1 Data Lo	Reg N Data Hi, Reg N Data Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	Returns the effect of reading register bytes	Returns multiple register data (one register data is two bytes)				CRC16 checksum of bytes 1 to N	

Function Code: 0X06

1.Host Request Frame:

1	2	3	4	5	6	7	8
ADR	0X06	Reg address Hi	Reg address Lo	Reg Data Hi	Reg Data Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	Register address to be written		Register data to be written		CRC16 checksum of bytes 1 to 6	

2.Slave Response Frame (Correct) :

1	2	3	4	5	6	7	8
ADR	0X06	Reg address Hi	Reg address Lo	Reg Data Hi	Reg Data Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	Returns the register address written		Returns the written register data		CRC16 checksum of bytes 1 to 6	

Function Code: 0X10

1.Host Request Frame:

1	2	3、4	5、6	7	8、9	10、11	N-1、N	N+1	N+2
ADR	0X10	Start Add	Reg Qty	Byte Count	Reg 1 Data	Reg 2 Data	Reg N Data	CRC Check	CRC Check
Module address (1~247)	Function code	The starting address of the register to be written	Validity of register written	Number of register data bytes written	Multiple register data written (One register data is two bytes)				CRC16 checksum of bytes 1 to N	

2.Slave Response Frame (Correct) :

1	2	3	4	5	6	7	8
ADR	0X10	Start Add Hi	Start Add Lo	Reg Qty Hi	Reg Qty Lo	CRC Lo	CRC Hi
Module address (1~247)	Function code	Returns the starting address of the register written		Returns the number of registers written		CRC16 checksum of bytes 1 to 6	

· Register Definition Table

PLC add	Register add (HEX)	Function Definition	R/W Attribute	Value Range and Description
40002	1	AC Voltage Value	Read Only	Unit: 0.01V. For example, if the reading is 22050, then the voltage is 220.5V
40003	2	AC Current Value	Read Only	Unit: 0.01A. For example, if the reading is 1043, then the current corresponds to 10.43A
40004	3	Active Power Low 16 Bits Data	Read Only	Unit: W (Watt). Composed of 2 registers, forming a signed 32-bit value
40005	4	Active Power High 16 Bits Data	Read Only	
40006	5	Reactive Power Low 16 Bits Data	Read Only	Unit: W (Watt). Composed of 2 registers, forming a signed 32-bit value
40007	6	Reactive Power High 16 Bits Data	Read Only	
40008	7	Apparent Power Low 16 Bits Data	Read Only	Unit: W (Watt). Composed of 2 registers, forming a signed 32-bit value
40009	8	Apparent Power High 16 Bits Data	Read Only	
40010	9	Power Factor	Read Only	This model does not support
40011	A	Phase Angle	Read Only	This model does not support
40012	B	Operating Frequency	Read Only	Unit: 0.1Hz
40013	C	Function Reserved	Read Only	Function Reserved
40014	D	Energy Value Low 16 Bits Data	Read Only	Unit: 0.01kWh. Composed of 2 registers. For example, if the low 16-bit reading is 1000 and the high 16-bit reading is 1, then the energy consumption is $(1 \times 65536 + 1000) \times 0.01 = 665.36$ kWh
40015	E	Energy Value High 16 Bits Data	Read Only	
40051	32	Range Upper Limit Low 16 Bits Set Value	Read-write	The set value corresponds to the parameter selected under "Output Parameter Selection"; refer to the description of the corresponding data for details
40052	33	Range Upper Limit High 16 Bits Set Value	Read-write	
40053	34	Range Lower Limit Low 16 Bits Set Value	Read-write	The set value corresponds to the parameter selected under "Output Parameter Selection"; refer to the description of the corresponding data for details
40054	35	Range Lower Limit High 16 Bits Set Value	Read-write	
40055	36	Output Parameter Selection	Read-write	0: Voltage 1: Current 2: Active Power 3: Reactive Power 4: Apparent Power 5: Power Factor 6: Phase Angle 7: Operating Frequency
40056	37	Output Signal Type	Read-write	0: 4~20mA 1: 0~20mA 2: 0~5V 3: 0~10V

40083	52	Communication Address	Read-write	1-247
40084	53	Baud Rate	Read-write	0: 1200bps 1: 2400bps 2: 4800bps 3: 9600bps 4: 14400bps 5: 19200bps 6: 38400bps 7: 56000bps 8: 57600bps 9: 115200bps
40085	54	Parity	Read-write	0: No parity, 1: Even parity, 2: Odd parity
40086	55	Stop bit	Read-write	0: 1 stop bit, 1: 0.5 stop bit, 2: 2 stop bits
40087	56	Device number 1	Read Only	0~65536
40088	57	Device number 1	Read Only	0~65536
40089	58	Firmware version	Read Only	0~65536
40090	59	Device type	Read Only	0~65536